


## HCI634G - Technical Data Sheet



## **HCI634G**

### **SPECIFICATIONS & OPTIONS**

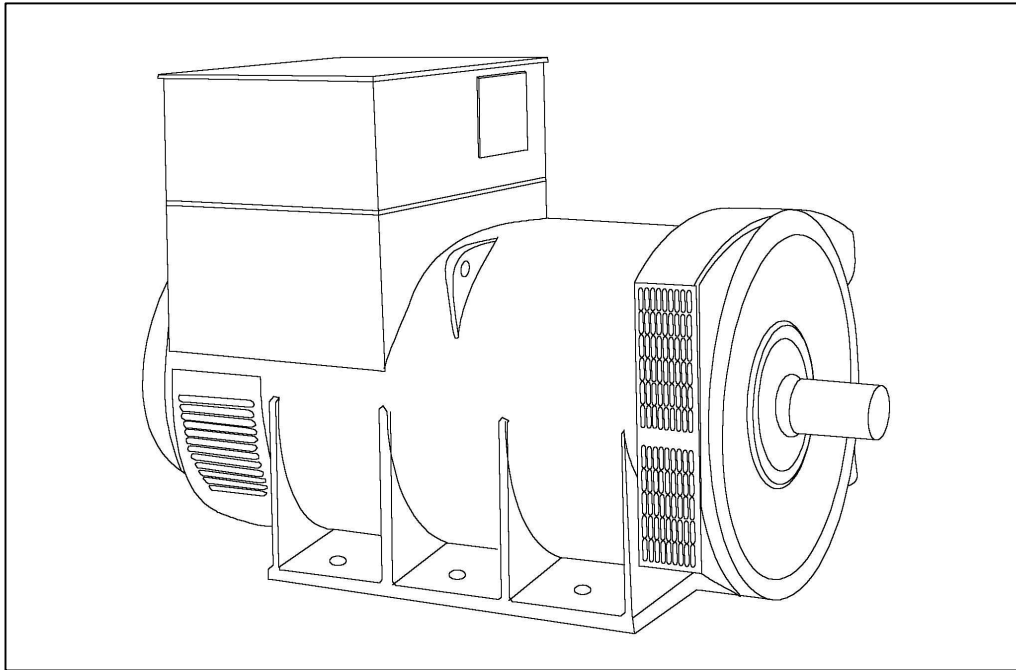

#### **STANDARDS**

Newage Stamford industrial generators meet the requirements of BS EN 60034 and the relevant section of other international standards such as BS5000, VDE 0530, NEMA MG1-32, IEC34, CSA C22.2-100, AS1359. Other standards and certifications can be considered on request.

#### **VOLTAGE REGULATORS**

##### **MX321 AVR - STANDARD**

This sophisticated Automatic Voltage Regulator (AVR) is incorporated into the Stamford Permanent Magnet Generator (PMG) system and is fitted as standard to generators of this type.

The PMG provides power via the AVR to the main exciter, giving a source of constant excitation power independent of generator output. The main exciter output is then fed to the main rotor, through a full wave bridge, protected by a surge suppressor. The AVR has in-built protection against sustained over-excitation, caused by internal or external faults. This de-excites the machine after a minimum of 5 seconds.

Over voltage protection is built-in and short circuit current level adjustments is an optional facility.

#### **WINDINGS & ELECTRICAL PERFORMANCE**

All generator stators are wound to 2/3 pitch. This eliminates triplen (3rd, 9th, 15th ...) harmonics on the voltage waveform and is found to be the optimum design for trouble-free supply of non-linear loads. The 2/3 pitch design avoids excessive neutral currents sometimes seen with higher winding pitches, when in parallel with the mains. A fully connected damper winding reduces oscillations during paralleling. This winding, with the 2/3 pitch and carefully selected pole and tooth designs, ensures very low waveform distortion.

#### **TERMINALS & TERMINAL BOX**

Standard generators feature a main stator with 6 ends brought out to the terminals, which are mounted on the frame at the non-drive end of the generator. A sheet steel terminal box contains the AVR and provides ample space for the customers' wiring and gland arrangements. It has removable panels for easy access.

#### **SHAFT & KEYS**

All generator rotors are dynamically balanced to better than BS6861:Part 1 Grade 2.5 for minimum vibration in operation. Two bearing generators are balanced with a half key.

#### **INSULATION/IMPREGNATION**

The insulation system is class 'H'.

All wound components are impregnated with materials and processes designed specifically to provide the high build required for static windings and the high mechanical strength required for rotating components.

#### **QUALITY ASSURANCE**

Generators are manufactured using production procedures having a quality assurance level to BS EN ISO 9001.

The stated voltage regulation may not be maintained in the presence of certain radio transmitted signals. Any change in performance will fall within the limits of Criteria 'B' of EN 61000-6-2:2001. At no time will the steady-state voltage regulation exceed 2%.

*NB Continuous development of our products entitles us to change specification details without notice, therefore they must not be regarded as binding.*

*Front cover drawing typical of product range.*

## HCI634G

### WINDING 312

|                         |                                                  |                          |
|-------------------------|--------------------------------------------------|--------------------------|
| CONTROL SYSTEM          | SEPARATELY EXCITED BY P.M.G.                     |                          |
| A.V.R.                  | MX321                                            |                          |
| VOLTAGE REGULATION      | ± 0.5 %                                          | With 4% ENGINE GOVERNING |
| SUSTAINED SHORT CIRCUIT | REFER TO SHORT CIRCUIT DECREMENT CURVES (page 7) |                          |





|                                      |                                                                                     |         |         |                                                     |                          |         |         |         |
|--------------------------------------|-------------------------------------------------------------------------------------|---------|---------|-----------------------------------------------------|--------------------------|---------|---------|---------|
| INSULATION SYSTEM                    | CLASS H                                                                             |         |         |                                                     |                          |         |         |         |
| PROTECTION                           | IP23                                                                                |         |         |                                                     |                          |         |         |         |
| RATED POWER FACTOR                   | 0.8                                                                                 |         |         |                                                     |                          |         |         |         |
| STATOR WINDING                       | DOUBLE LAYER LAP                                                                    |         |         |                                                     |                          |         |         |         |
| WINDING PITCH                        | TWO THIRDS                                                                          |         |         |                                                     |                          |         |         |         |
| WINDING LEADS                        | 6                                                                                   |         |         |                                                     |                          |         |         |         |
| STATOR WDG. RESISTANCE               | 0.003 Ohms PER PHASE AT 22°C STAR CONNECTED                                         |         |         |                                                     |                          |         |         |         |
| ROTOR WDG. RESISTANCE                | 1.75 Ohms at 22°C                                                                   |         |         |                                                     |                          |         |         |         |
| EXCITER STATOR RESISTANCE            | 17 Ohms at 22°C                                                                     |         |         |                                                     |                          |         |         |         |
| EXCITER ROTOR RESISTANCE             | 0.079 Ohms PER PHASE AT 22°C                                                        |         |         |                                                     |                          |         |         |         |
| R.F.I. SUPPRESSION                   | BS EN 61000-6-2 & BS EN 61000-6-4,VDE 0875G, VDE 0875N. refer to factory for others |         |         |                                                     |                          |         |         |         |
| WAVEFORM DISTORTION                  | NO LOAD < 1.5% NON-DISTORTING BALANCED LINEAR LOAD < 5.0%                           |         |         |                                                     |                          |         |         |         |
| MAXIMUM OVERSPEED                    | 2250 Rev/Min                                                                        |         |         |                                                     |                          |         |         |         |
| BEARING DRIVE END                    | BALL. 6224 (ISO)                                                                    |         |         |                                                     |                          |         |         |         |
| BEARING NON-DRIVE END                | BALL. 6317 (ISO)                                                                    |         |         |                                                     |                          |         |         |         |
|                                      | 1 BEARING                                                                           |         |         |                                                     | 2 BEARING                |         |         |         |
| WEIGHT COMP. GENERATOR               | 1965 kg                                                                             |         |         |                                                     | 1989 kg                  |         |         |         |
| WEIGHT WOUND STATOR                  | 934 kg                                                                              |         |         |                                                     | 934 kg                   |         |         |         |
| WEIGHT WOUND ROTOR                   | 814 kg                                                                              |         |         |                                                     | 766 kg                   |         |         |         |
| WR² INERTIA                          | 18.3482 kgm <sup>2</sup>                                                            |         |         |                                                     | 17.8009 kgm <sup>2</sup> |         |         |         |
| SHIPPING WEIGHTS in a crate          | 2023kg                                                                              |         |         |                                                     | 2029kg                   |         |         |         |
| PACKING CRATE SIZE                   | 183 x 92 x 140(cm)                                                                  |         |         |                                                     | 183 x 92 x 140(cm)       |         |         |         |
|                                      | 50 Hz                                                                               |         |         |                                                     | 60 Hz                    |         |         |         |
| TELEPHONE INTERFERENCE               | THF<2%                                                                              |         |         |                                                     | TIF<50                   |         |         |         |
| COOLING AIR                          | 1.614 m³/sec 3420 cfm                                                               |         |         |                                                     | 1.961 m³/sec 4156 cfm    |         |         |         |
| VOLTAGE STAR                         | 380/220                                                                             | 400/231 | 415/240 | 440/254                                             | 416/240                  | 440/254 | 460/266 | 480/277 |
| VOLTAGE DELTA                        | 220                                                                                 | 230     | 240     | 254                                                 | 240                      | 254     | 266     | 277     |
| kVA BASE RATING FOR REACTANCE VALUES | 800                                                                                 | 800     | 800     | 800                                                 | 875                      | 925     | 963     | 1000    |
| Xd DIR. AXIS SYNCHRONOUS             | 3.14                                                                                | 2.83    | 2.63    | 2.34                                                | 3.53                     | 3.34    | 3.18    | 3.03    |
| X'd DIR. AXIS TRANSIENT              | 0.25                                                                                | 0.23    | 0.21    | 0.19                                                | 0.28                     | 0.26    | 0.25    | 0.24    |
| X''d DIR. AXIS SUBTRANSIENT          | 0.18                                                                                | 0.16    | 0.15    | 0.13                                                | 0.21                     | 0.20    | 0.19    | 0.18    |
| Xq QUAD. AXIS REACTANCE              | 1.88                                                                                | 1.70    | 1.58    | 1.40                                                | 2.10                     | 1.98    | 1.89    | 1.80    |
| X''q QUAD. AXIS SUBTRANSIENT         | 0.21                                                                                | 0.19    | 0.18    | 0.16                                                | 0.24                     | 0.23    | 0.22    | 0.21    |
| XL LEAKAGE REACTANCE                 | 0.10                                                                                | 0.09    | 0.08    | 0.07                                                | 0.12                     | 0.11    | 0.10    | 0.10    |
| X2 NEGATIVE SEQUENCE                 | 0.22                                                                                | 0.20    | 0.19    | 0.17                                                | 0.24                     | 0.23    | 0.22    | 0.21    |
| X0 ZERO SEQUENCE                     | 0.03                                                                                | 0.03    | 0.03    | 0.02                                                | 0.03                     | 0.03    | 0.03    | 0.03    |
| REACTANCES ARE SATURATED             |                                                                                     |         |         | VALUES ARE PER UNIT AT RATING AND VOLTAGE INDICATED |                          |         |         |         |
| T'd TRANSIENT TIME CONST.            | 0.185                                                                               |         |         |                                                     |                          |         |         |         |
| T''d SUB-TRANSTIME CONST.            | 0.025                                                                               |         |         |                                                     |                          |         |         |         |
| T'do O.C. FIELD TIME CONST.          | 2.35                                                                                |         |         |                                                     |                          |         |         |         |
| Ta ARMATURE TIME CONST.              | 0.04                                                                                |         |         |                                                     |                          |         |         |         |
| SHORT CIRCUIT RATIO                  | 1/Xd                                                                                |         |         |                                                     |                          |         |         |         |

**50  
Hz**

**HCI634G**  
Winding 312

**STAMFORD**  
power generation

**THREE PHASE EFFICIENCY CURVES**

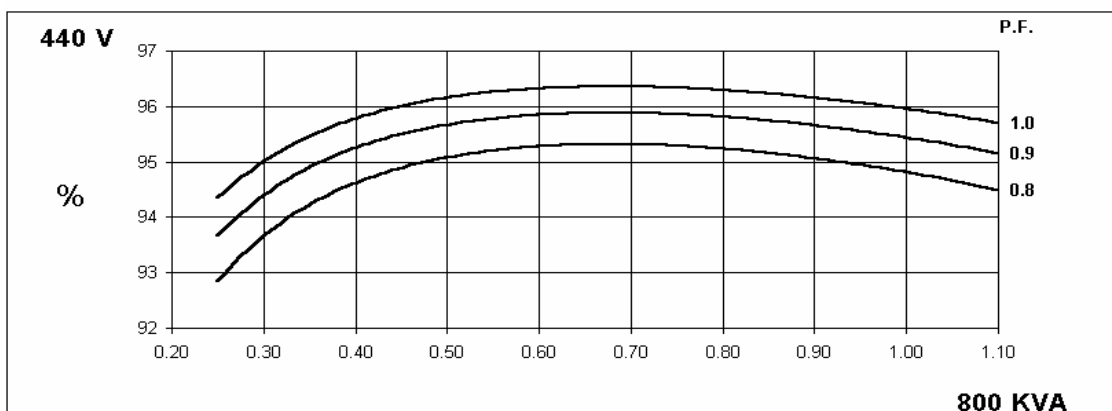
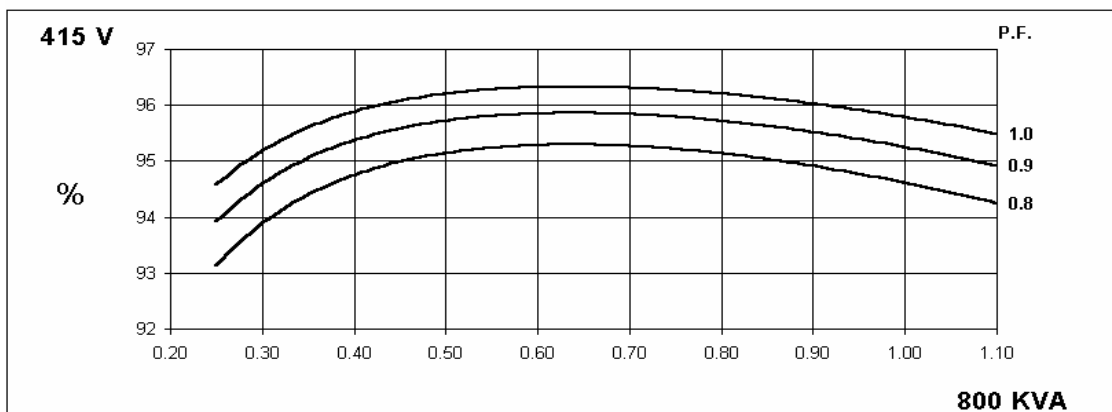
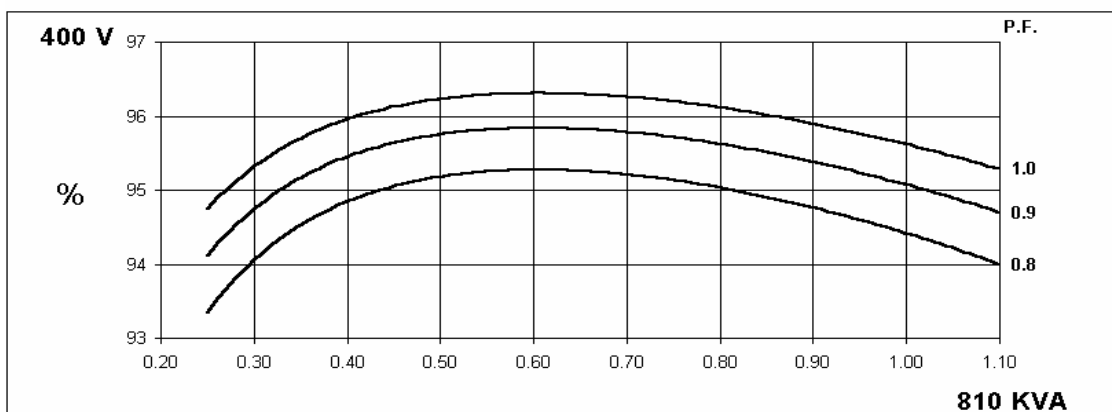
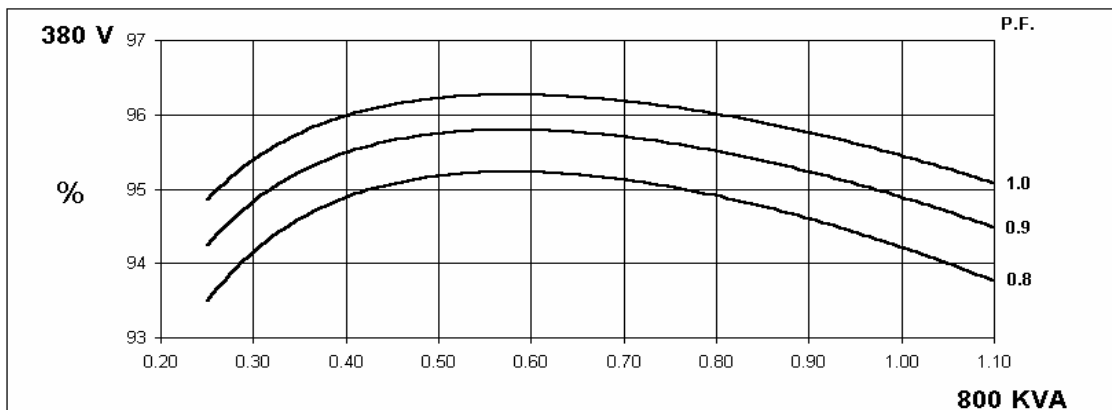


# HCI634G

## Winding 312

**60  
Hz**



### THREE PHASE EFFICIENCY CURVES

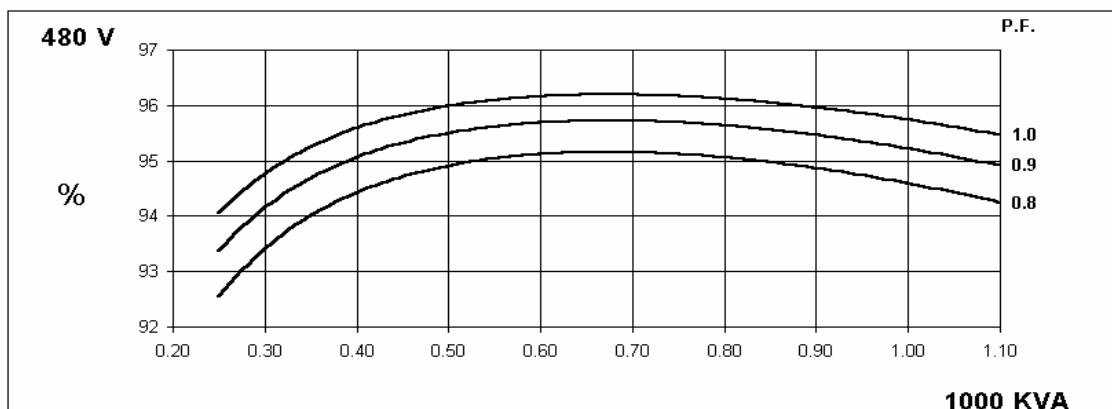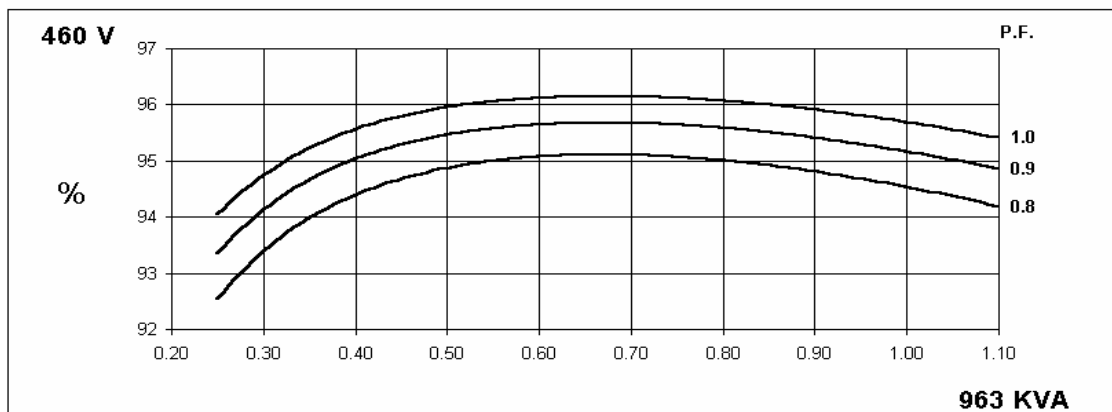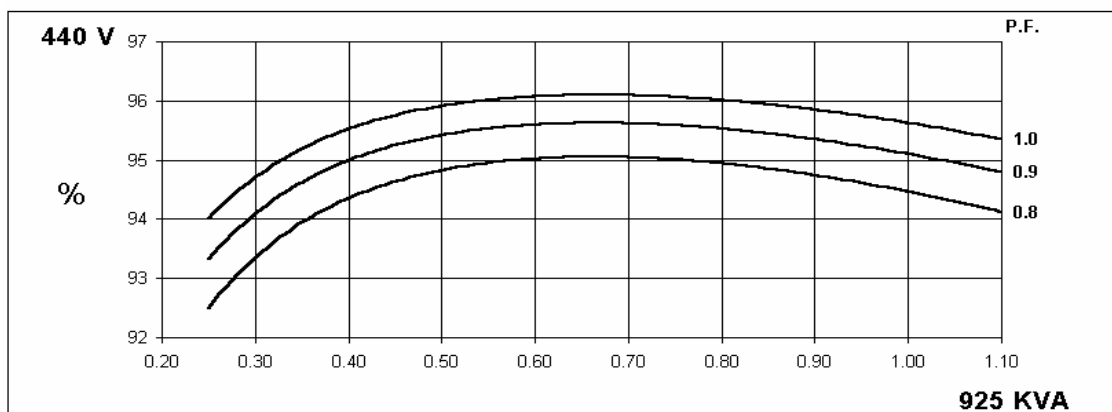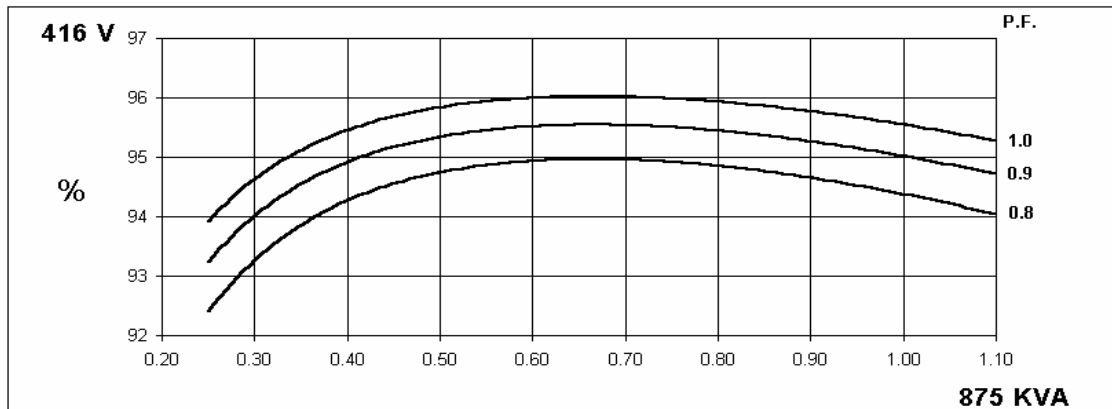

# HCI634G


## Winding 312

Locked Rotor Motor Starting Curve

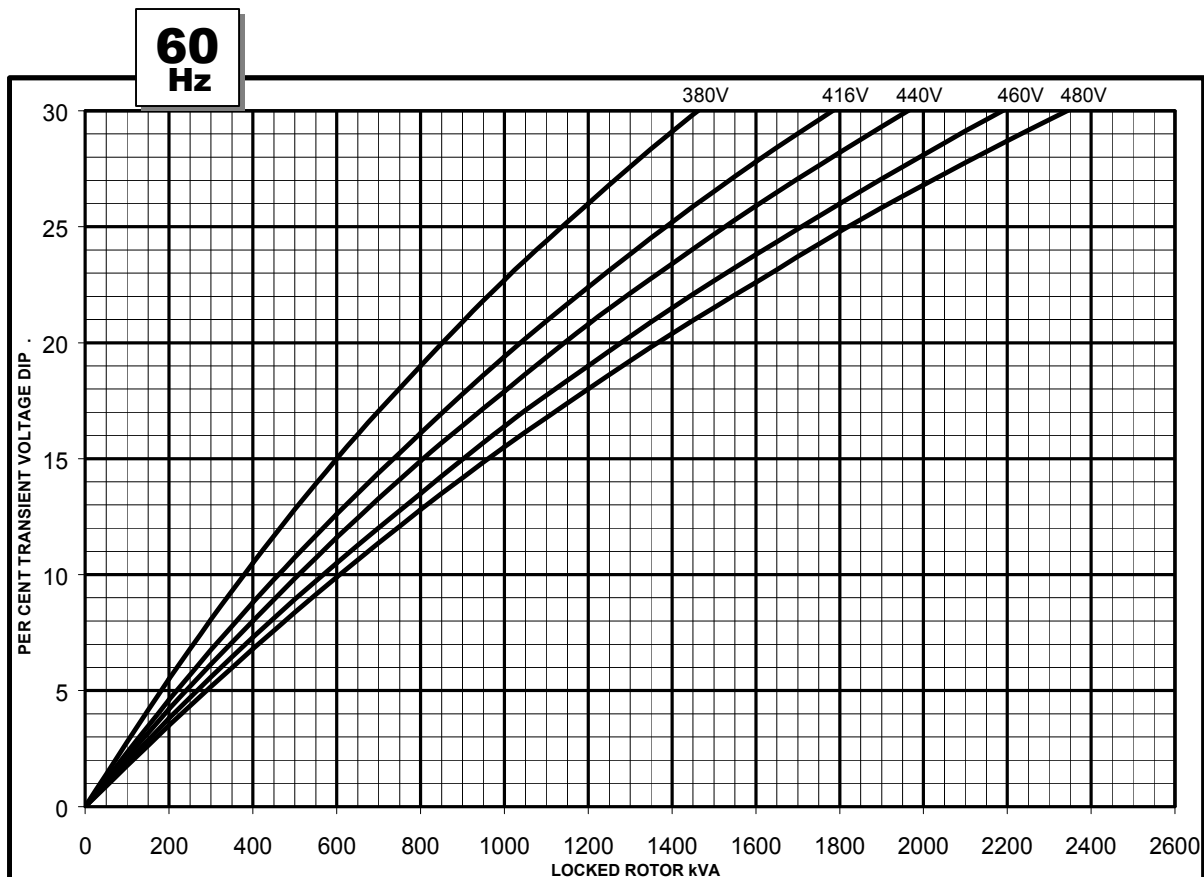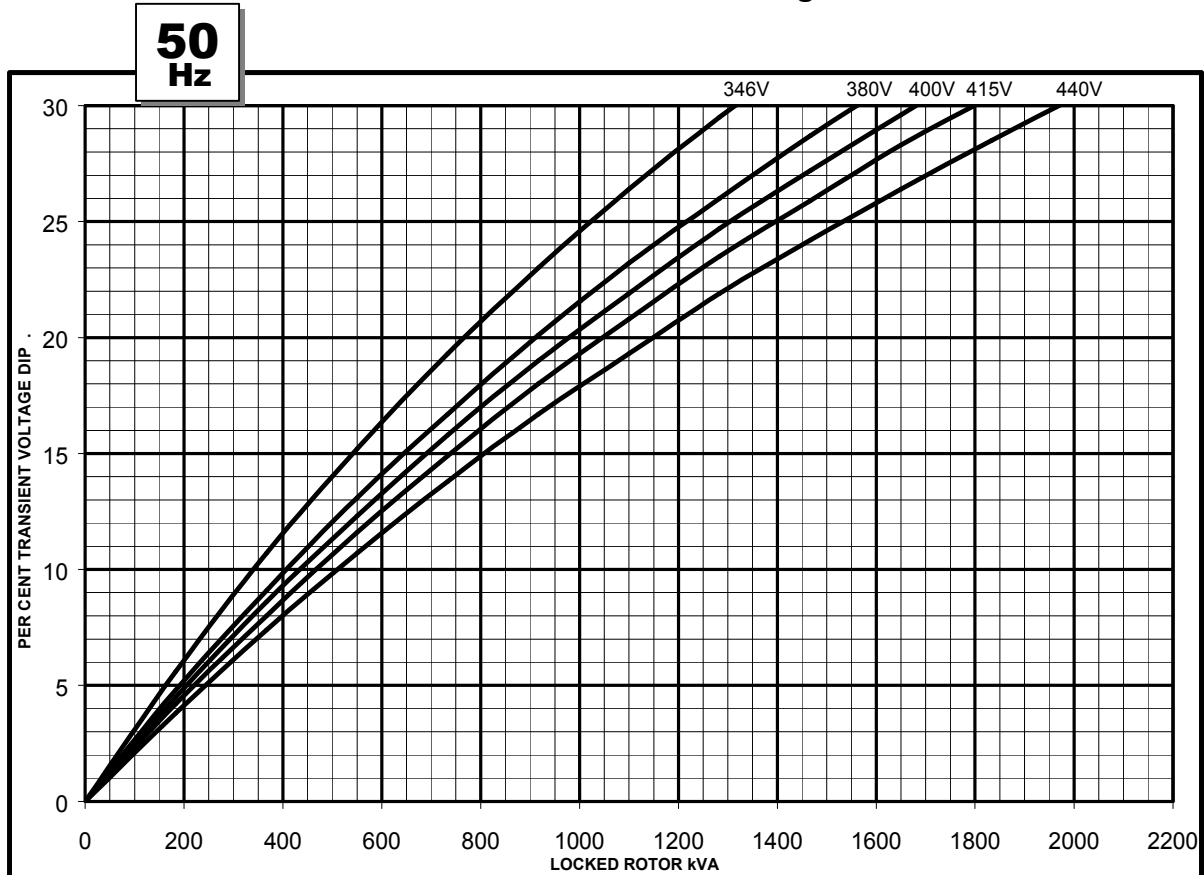


**Three-phase Short Circuit Decrement Curve. No-load Excitation at Rated Speed  
Based on star (wye) connection.**

**50  
Hz**

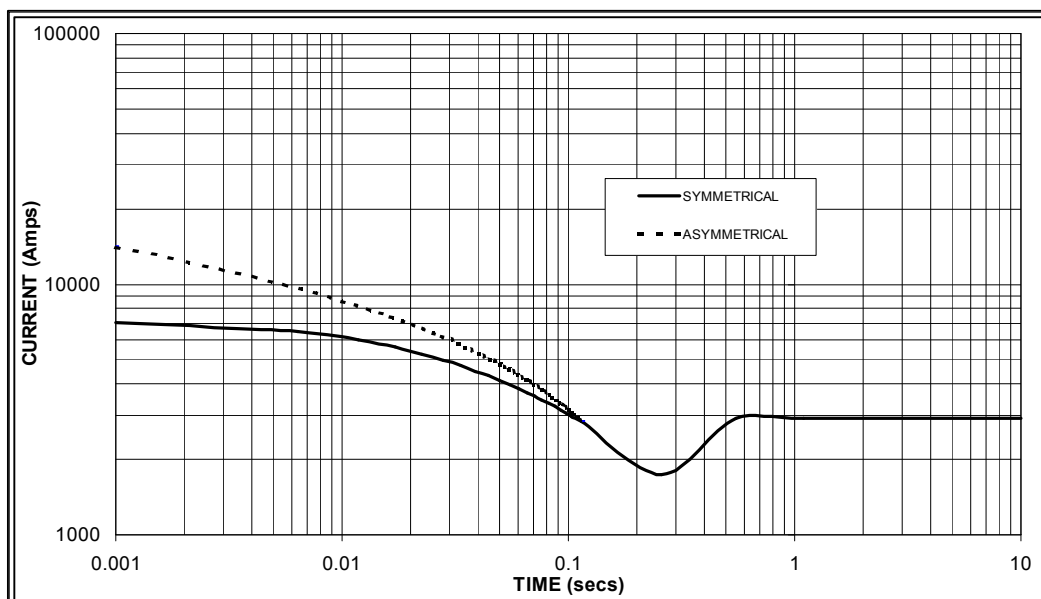

Sustained Short Circuit = 2,900 Amps

**60  
Hz**

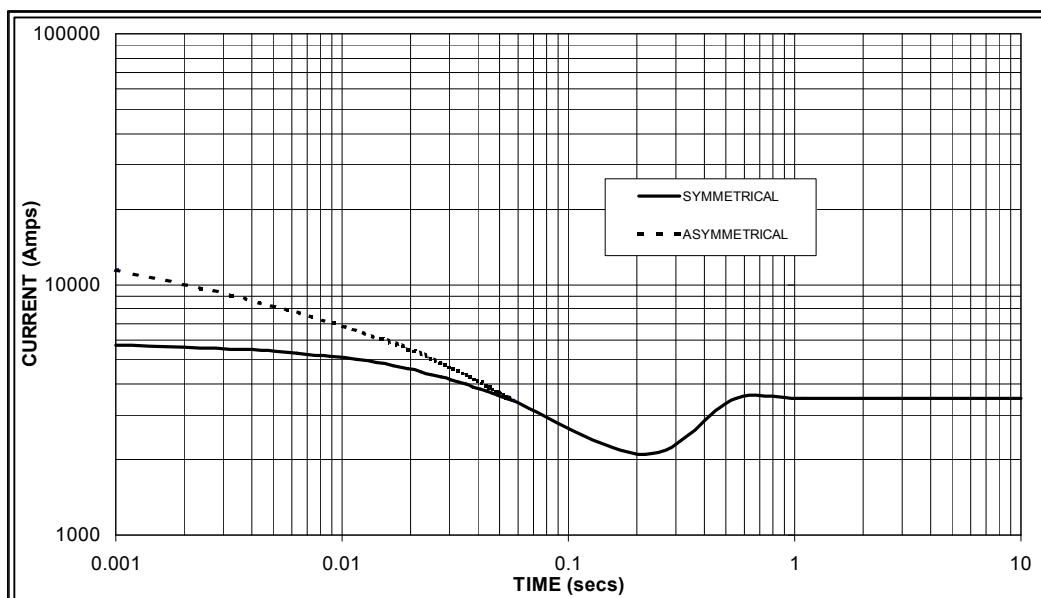

Sustained Short Circuit = 3,500 Amps

**Note 1**

The following multiplication factors should be used to adjust the values from curve between time 0.001 seconds and the minimum current point in respect of nominal operating voltage :

| 50Hz    |        | 60Hz    |        |
|---------|--------|---------|--------|
| Voltage | Factor | Voltage | Factor |
| 380v    | X 1.00 | 416v    | x 1.00 |
| 400v    | X 1.07 | 440v    | x 1.06 |
| 415v    | X 1.12 | 460v    | x 1.12 |
| 440v    | X 1.18 | 480v    | x 1.17 |

The sustained current value is constant irrespective of voltage level

**Note 2**

The following multiplication factor should be used to convert the values calculated in accordance with NOTE 1 to those applicable to the various types of short circuit :

|                         | 3-phase | 2-phase L-L | 1-phase L-N |
|-------------------------|---------|-------------|-------------|
| Instantaneous           | x 1.00  | x 0.87      | x 1.30      |
| Minimum                 | x 1.00  | x 1.80      | x 3.20      |
| Sustained               | x 1.00  | x 1.50      | x 2.50      |
| Max. sustained duration | 10 sec. | 5 sec.      | 2 sec.      |

All other times are unchanged

**Note 3**

Curves are drawn for Star (Wye) connected machines. For Delta connection multiply the Curve current value by 1.732

## HCI634G

**Winding 312 0.8 Power Factor**




### RATINGS

| Class - Temp Rise |                | Cont. F - 105/40°C |      |      |      | Cont. H - 125/40°C |      |      |      | Standby - 150/40°C |      |      |      | Standby - 163/27°C |      |      |      |
|-------------------|----------------|--------------------|------|------|------|--------------------|------|------|------|--------------------|------|------|------|--------------------|------|------|------|
| 50Hz              | Star (V)       | 380                | 400  | 415  | 440  | 380                | 400  | 415  | 440  | 380                | 400  | 415  | 440  | 380                | 400  | 415  | 440  |
|                   | Delta (V)      | 220                | 230  | 240  | 254  | 220                | 230  | 240  | 254  | 220                | 230  | 240  | 254  | 220                | 230  | 240  | 254  |
|                   | kVA            | 750                | 760  | 750  | 750  | 800                | 810  | 800  | 800  | 820                | 830  | 820  | 820  | 850                | 860  | 850  | 850  |
|                   | kW             | 600                | 608  | 600  | 600  | 640                | 648  | 640  | 640  | 656                | 664  | 656  | 656  | 680                | 688  | 680  | 680  |
|                   | Efficiency (%) | 94.5               | 94.6 | 94.8 | 95.0 | 94.2               | 94.4 | 94.6 | 94.8 | 94.1               | 94.3 | 94.5 | 94.7 | 93.9               | 94.2 | 94.4 | 94.6 |
|                   | kW Input       | 635                | 643  | 633  | 632  | 679                | 686  | 677  | 675  | 697                | 704  | 694  | 693  | 724                | 730  | 720  | 719  |

|             |                |      |      |      |      |      |      |      |      |      |      |      |      |      |      |      |      |
|-------------|----------------|------|------|------|------|------|------|------|------|------|------|------|------|------|------|------|------|
| <b>60Hz</b> | Star (V)       | 416  | 440  | 460  | 480  | 416  | 440  | 460  | 480  | 416  | 440  | 460  | 480  | 416  | 440  | 460  | 480  |
|             | Delta (V)      | 240  | 254  | 266  | 277  | 240  | 254  | 266  | 277  | 240  | 254  | 266  | 277  | 240  | 254  | 266  | 277  |
|             | kVA            | 813  | 844  | 888  | 913  | 875  | 925  | 963  | 1000 | 913  | 969  | 1008 | 1046 | 950  | 1000 | 1044 | 1088 |
|             | kW             | 650  | 675  | 710  | 730  | 700  | 740  | 770  | 800  | 730  | 775  | 806  | 837  | 760  | 800  | 835  | 870  |
|             | Efficiency (%) | 94.6 | 94.7 | 94.8 | 94.8 | 94.4 | 94.5 | 94.5 | 94.6 | 94.2 | 94.3 | 94.4 | 94.4 | 94.1 | 94.2 | 94.3 | 94.3 |
|             | kW Input       | 688  | 713  | 749  | 770  | 742  | 783  | 815  | 846  | 775  | 822  | 854  | 886  | 808  | 849  | 886  | 923  |

### DIMENSIONS

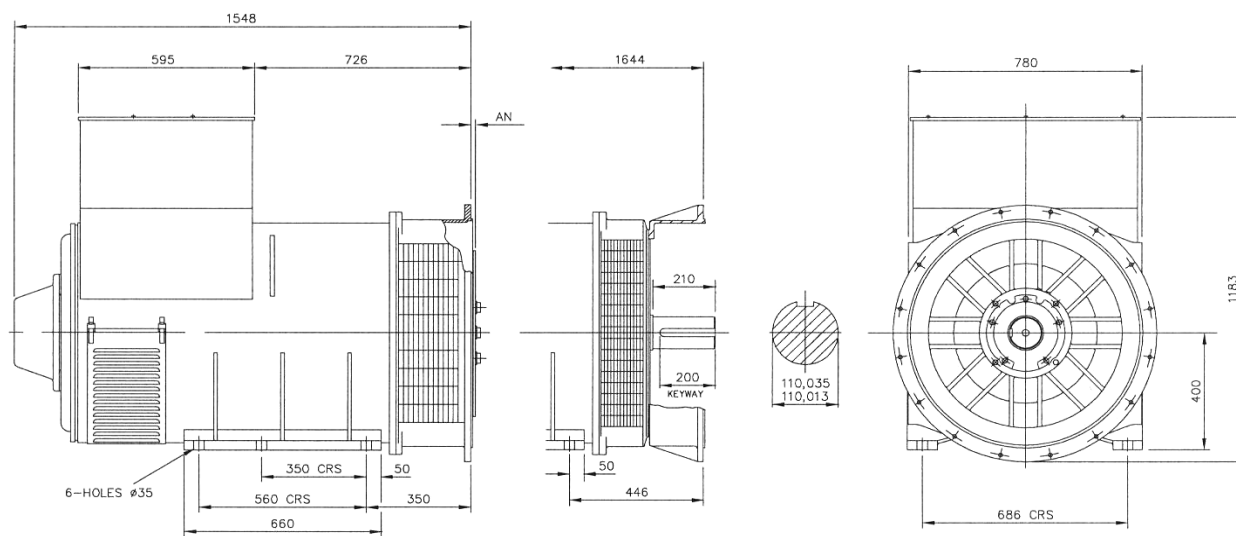

|            |      |       |    |    |
|------------|------|-------|----|----|
| <b>SAE</b> | 14   | 18    | 21 | 24 |
| <b>AN</b>  | 25.4 | 15.87 | 0  | 0  |

**Barnack Road • Stamford • Lincolnshire • PE9 2NB**  
**Tel: 00 44 (0)1780 484000 • Fax: 00 44 (0)1780 484100**  
**Website: [www.newage-avkseg.com](http://www.newage-avkseg.com)**